


LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:220.99V I:0.1529A P:33.145W PF:0.9810 Freq:50.00Hz Lamp Flux:2386.67x2 lm		
NAME: IT-TRS-24-36	TYPE:3500K	WEIGHT:
SPEC.:2x4FT	DIM.:	SERIAL No.:
MFR.:	SUR.:0.53*1.1M	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA Eff: 141.89 lm/W			
MODEL		Imax(cd)	1337	S/MH(C0/180)	1.40
NOMINAL POWER(W)		LOR(%)	98.5	S/MH(C90/270)	1.26
RATED VOLTAGE(V)	220.0	TOTAL FLUX(lm)	4703.0	η UP,DN(C0-180)	0.1,50.0
NOMINAL FLUX(lm)	2386.67	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.0,48.4
LAMPS INSIDE	2	η up(%)	0.1	CIBSE SHR NOM	1.50
TEST VOLTAGE(V)	220.0	η down(%)	98.4	CIBSE SHR MAX	1.55

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

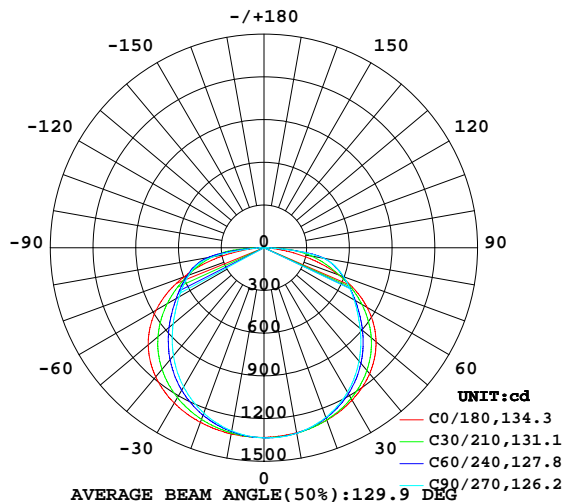

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

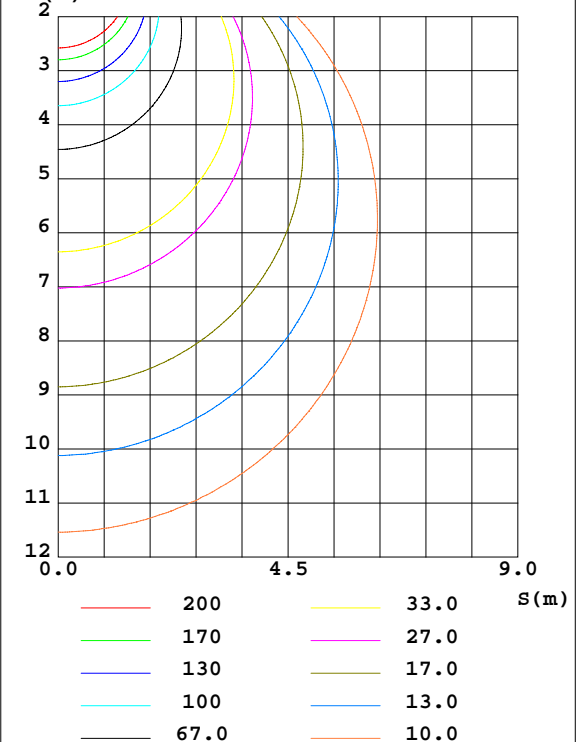

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.0DEG
Operators:朱法春
Test Date:2023-02-11

γ Range: 0 - 180DEG
 γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.0.366
Humidity:32%
Test Distance:1.100m [K=1.0954]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:


γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	Φ lum, lamp
10	1318	1323	1322	1328	1327	1316	1305	1312	0- 10	126.6	126.6	2.69,2.65
20	1288	1280	1268	1293	1305	1267	1236	1261	10- 20	367.7	494.4	10.5,10.4
30	1237	1204	1173	1225	1259	1186	1128	1178	20- 30	572.6	1067	22.7,22.4
40	1154	1092	1038	1121	1183	1070	989.3	1063	30- 40	718.7	1786	38,37.4
50	1026	943.2	881.3	978.8	1061	920.7	832.6	913.6	40- 50	787.1	2573	54.7,53.9
60	836.0	767.0	731.1	802.2	873.2	747.3	688.5	736.5	50- 60	768.1	3341	71,70
70	559.4	578.3	594.6	605.4	598.3	571.0	562.1	552.3	60- 70	668.6	4009	85.3,84
80	212.9	384.7	424.9	401.7	251.1	384.9	358.2	355.3	70- 80	500.4	4510	95.9,94.5
90	1.024	1.001	1.316	13.69	5.539	3.441	0.6781	0.7577	80- 90	188.0	4698	99.9,98.4
100	0.7370	0.6678	0.6286	0.7443	0.8605	0.8254	0.7557	0.6458	90-100	0.9770	4699	99.9,98.4
110	0.8510	0.8319	0.8726	0.8787	0.6853	0.8256	0.8056	0.5745	100-110	0.7994	4700	99.9,98.5
120	0.7665	0.9034	1.004	0.9279	0.7236	0.8430	0.8091	0.5359	110-120	0.8007	4701	99.9,98.5
130	0.6950	0.8938	1.071	0.9039	0.7282	0.8300	0.7707	0.5647	120-130	0.7237	4701	100,98.5
140	0.7544	0.9213	0.9971	0.8789	0.6861	0.8831	0.7856	0.6379	130-140	0.6299	4702	100,98.5
150	0.7555	0.8743	0.8517	0.8163	0.6806	0.9140	0.8190	0.6740	140-150	0.5119	4702	100,98.5
160	0.7612	0.7342	0.7143	0.7505	0.7637	0.8971	0.7694	0.6383	150-160	0.3619	4703	100,98.5
170	0.7599	0.6683	0.5837	0.7101	0.8025	0.8747	0.8066	0.6881	160-170	0.2094	4703	100,98.5
180	0.7736	0.8122	0.7420	0.7062	0.7757	0.8010	0.8010	0.7075	170-180	0.0713	4703	100,98.5
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

C Range: 0 - 360DEG
 C Interval: 30.0DEG
 Test Speed: HIGH
 Temperature:25.0DEG
 Operators:朱法春
 Test Date:2023-02-11

γ Range: 0 - 180DEG
 γ Interval: 0.5DEG
 Test System:EVERFINE GO-R5000_V2 SYSTEM V2.0.366
 Humidity:32%
 Test Distance:1.100m [K=1.0954]
 Remarks:

LUMINANCE LIMITATION CURVES

Test:U:220.99V I:0.1529A P:33.145W PF:0.9810 Freq:50.00Hz Lamp Flux:2386.67x2 lm		
NAME: IT-TRS-24-36	TYPE:3500K	WEIGHT:
SPEC.:2x4FT	DIM.:	SERIAL No.:
MFR.:	SUR.:0.53*1.1M	Shielding Angle:

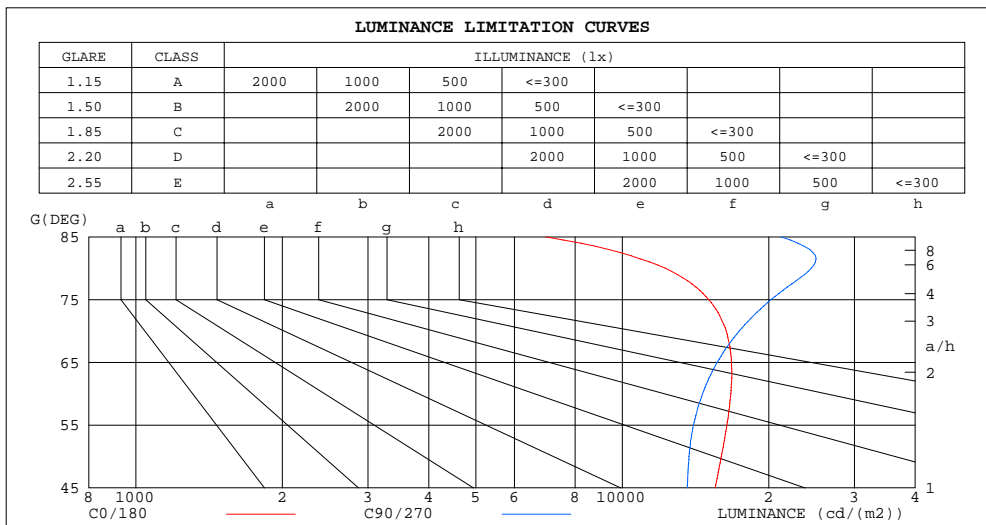

LUMINANCE cd/(m2)		
G(DEG)	C0/180	C90/270
85	6957	21179
80	12259	24468
75	15047	20218
70	16355	17385
65	16754	15666
60	16720	14622
55	16398	14003
50	15969	13710
45	15526	13606


C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.0DEG
Operators:朱法春
Test Date:2023-02-11

γ Range: 0 - 180DEG
 γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.0.366
Humidity:32%
Test Distance:1.100m [K=1.0954]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:220.99V I:0.1529A P:33.145W PF:0.9810 Freq:50.00Hz Lamp Flux:2386.67x2 lm		
NAME: IT-TRS-24-36	TYPE:3500K	WEIGHT:
SPEC.:2x4FT	DIM.:	SERIAL No.:
MFR.:	SUR.:0.53*1.1M	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.17	1.17	1.17	1.15	1.15	1.15	1.09	1.09	1.09	1.05	1.05	1.05	1.00	1.00	1.00	.98
1.0	.00	.95	.91	.98	.93	.89	.93	.90	.86	.89	.86	.84	.86	.83	.81	.79
2.0	.86	.78	.72	.84	.77	.71	.80	.74	.69	.77	.72	.68	.74	.70	.66	.64
3.0	.74	.66	.58	.73	.65	.58	.70	.63	.57	.67	.61	.56	.64	.59	.55	.52
4.0	.65	.56	.49	.64	.55	.48	.61	.54	.48	.59	.52	.47	.57	.51	.46	.44
5.0	.58	.48	.41	.57	.48	.41	.55	.47	.41	.53	.46	.40	.51	.45	.40	.38
6.0	.52	.43	.36	.51	.42	.36	.49	.41	.35	.47	.40	.35	.46	.40	.35	.32
7.0	.47	.38	.31	.46	.37	.31	.45	.37	.31	.43	.36	.31	.42	.35	.31	.28
8.0	.43	.34	.28	.42	.34	.28	.41	.33	.28	.39	.32	.27	.38	.32	.27	.25
9.0	.39	.31	.25	.38	.30	.25	.37	.30	.25	.36	.29	.25	.35	.29	.24	.22
10.0	.36	.28	.22	.35	.28	.22	.34	.27	.22	.33	.27	.22	.33	.26	.22	.20

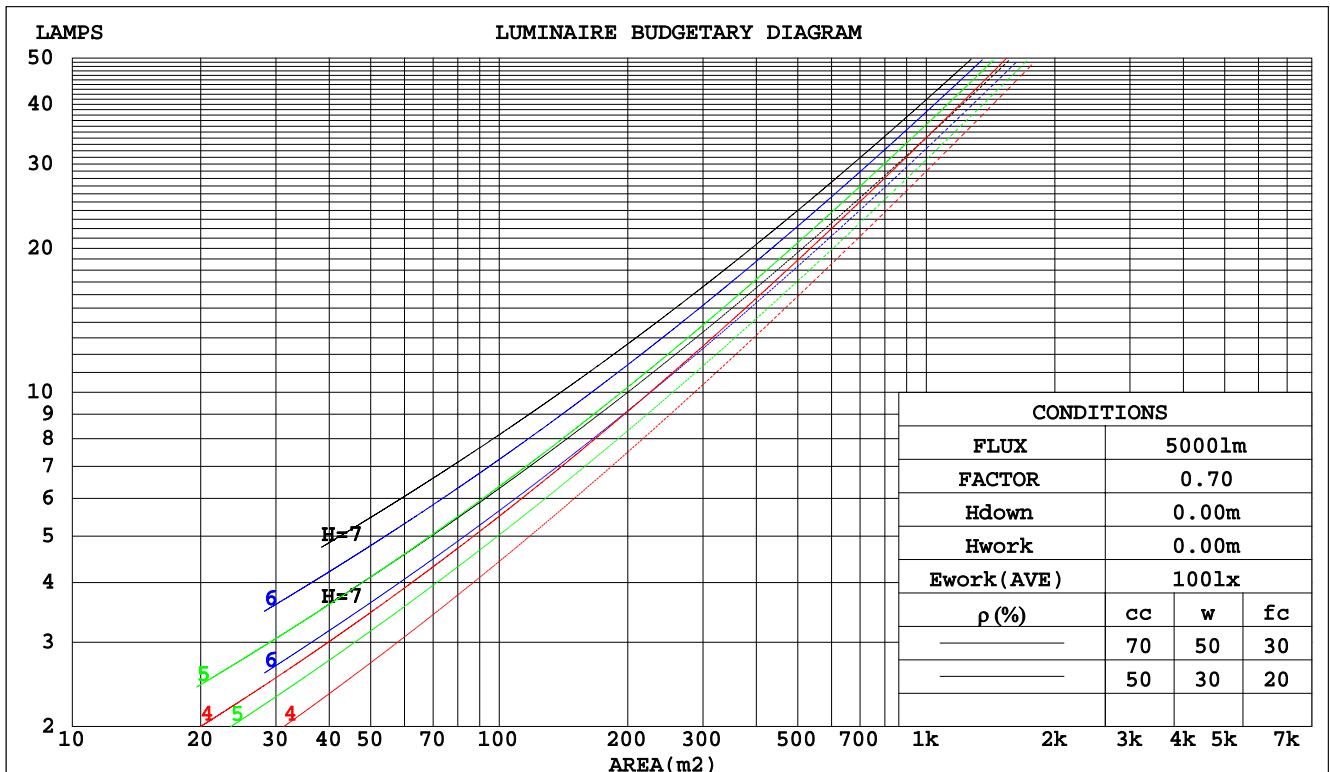

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.0DEG
Operators:朱法春
Test Date:2023-02-11

γ Range: 0 - 180DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.0.366
Humidity:32%
Test Distance:1.100m [K=1.0954]
Remarks:

WEC AND CCEC

Test:U:220.99V I:0.1529A P:33.145W PF:0.9810 Freq:50.00Hz Lamp Flux:2386.67x2 lm					
NAME: IT-TRS-24-36			TYPE:3500K		WEIGHT:
SPEC.:2x4FT			DIM.:		SERIAL No.:
MFR.:			SUR.:0.53*1.1M		Shielding Angle:

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)									
0.0																
1.0	.352	.200	.063	.345	.197	.062	.331	.190	.061	.319	.184	.059	.308	.178	.057	
2.0	.320	.175	.054	.314	.173	.053	.302	.168	.052	.291	.163	.051	.281	.159	.050	
3.0	.290	.155	.046	.285	.153	.046	.274	.149	.045	.265	.145	.044	.255	.141	.044	
4.0	.264	.137	.040	.259	.136	.040	.250	.133	.040	.241	.130	.039	.233	.127	.039	
5.0	.242	.123	.036	.237	.122	.035	.229	.119	.035	.221	.117	.035	.214	.114	.034	
6.0	.222	.111	.032	.218	.110	.032	.211	.108	.031	.204	.106	.031	.198	.104	.031	
7.0	.205	.102	.029	.202	.101	.029	.195	.099	.028	.189	.097	.028	.183	.095	.028	
8.0	.191	.093	.026	.188	.092	.026	.182	.091	.026	.176	.089	.026	.171	.088	.026	
9.0	.178	.086	.024	.175	.085	.024	.170	.084	.024	.165	.083	.024	.160	.081	.024	
10.0	.167	.080	.022	.164	.079	.022	.160	.078	.022	.155	.077	.022	.151	.076	.022	

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients(CCEC)									
0.0	.188	.188	.188	.161	.161	.161	.110	.110	.110	.063	.063	.063	.020	.020	.020	
1.0	.182	.154	.130	.155	.132	.111	.106	.091	.077	.061	.053	.045	.020	.017	.014	
2.0	.175	.131	.093	.150	.112	.081	.103	.078	.056	.059	.045	.033	.019	.015	.011	
3.0	.168	.114	.071	.144	.098	.061	.099	.068	.043	.057	.040	.025	.018	.013	.008	
4.0	.160	.101	.056	.137	.087	.048	.094	.061	.034	.055	.036	.020	.018	.012	.007	
5.0	.152	.091	.045	.131	.078	.039	.090	.055	.028	.052	.032	.016	.017	.010	.005	
6.0	.145	.083	.038	.125	.071	.033	.086	.050	.023	.050	.029	.014	.016	.010	.005	
7.0	.138	.076	.032	.119	.066	.028	.082	.046	.020	.048	.027	.012	.015	.009	.004	
8.0	.131	.070	.028	.113	.061	.024	.078	.043	.017	.045	.025	.010	.015	.008	.003	
9.0	.125	.065	.025	.108	.057	.022	.075	.040	.015	.043	.023	.009	.014	.008	.003	
10.0	.119	.061	.022	.103	.053	.019	.071	.037	.014	.041	.022	.008	.013	.007	.003	

C Range: 0 - 360DEG
 C Interval: 30.0DEG
 Test Speed: HIGH
 Temperature:25.0DEG
 Operators:朱法春
 Test Date:2023-02-11

γ Range: 0 - 180DEG
 γ Interval: 0.5DEG
 Test System:EVERFINE GO-R5000_V2 SYSTEM V2.0.366
 Humidity:32%
 Test Distance:1.100m [K=1.0954]
 Remarks:

UGR(Unified Glare Rating) Table

Test:U:220.99V I:0.1529A P:33.145W PF:0.9810 Freq:50.00Hz Lamp Flux:2386.67x2 lm											
NAME: IT-TRS-24-36					TYPE:3500K			WEIGHT:			
SPEC.:2x4FT					DIM.:			SERIAL No.:			
MFR.:					SUR.:0.53*1.1M			Shielding Angle:			
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3	
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3	
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	
Room dimensions		Viewed crosswise				Viewed endwise					
x = 2H y = 2H	2H	22.7	24.4	23.0	24.6	24.8	22.1	23.7	22.4	23.9	24.2
	3H	24.6	26.1	24.9	26.4	26.6	24.4	25.9	24.7	26.1	26.4
	4H	25.4	26.8	25.7	27.1	27.4	25.6	27.0	25.9	27.3	27.6
	6H	25.9	27.3	26.3	27.6	27.8	26.9	28.2	27.2	28.5	28.8
	8H	26.0	27.4	26.4	27.6	28.0	27.4	28.7	27.7	29.0	29.3
	12H	26.1	27.4	26.4	27.7	28.0	27.7	28.9	28.0	29.2	29.6
4H	2H	23.4	24.8	23.7	25.1	25.4	23.0	24.4	23.3	24.7	24.9
	3H	25.5	26.8	25.9	27.1	27.4	25.4	26.7	25.8	27.0	27.3
	4H	26.5	27.6	26.9	28.0	28.3	26.8	28.0	27.2	28.3	28.7
	6H	27.2	28.2	27.6	28.6	29.0	28.3	29.3	28.7	29.7	30.0
	8H	27.4	28.4	27.8	28.7	29.1	28.9	29.8	29.3	30.2	30.6
	12H	27.5	28.4	27.9	28.8	29.2	29.2	30.1	29.7	30.5	30.9
8H	4H	27.0	28.0	27.4	28.4	28.7	27.3	28.3	27.7	28.7	29.1
	6H	28.0	28.8	28.4	29.2	29.7	29.0	29.8	29.5	30.2	30.7
	8H	28.4	29.1	28.8	29.5	30.0	29.8	30.5	30.2	30.9	31.4
	12H	28.6	29.2	29.1	29.7	30.2	30.2	30.9	30.7	31.3	31.8
12H	4H	27.1	28.0	27.6	28.4	28.8	27.4	28.3	27.8	28.7	29.1
	6H	28.2	29.0	28.7	29.4	29.9	29.2	29.9	29.6	30.3	30.8
	8H	28.7	29.3	29.2	29.8	30.3	30.0	30.6	30.5	31.1	31.6
Variations with the observer position at spacings:											
S = 1.0H	+ 0.1 / - 0.1					+ 0.1 / - 0.1					
1.5H	+ 0.2 / - 0.3					+ 0.2 / - 0.2					
2.0H	+ 0.1 / - 0.3					+ 0.1 / - 0.3					

CIE Pub.117, 4773 lm Total Lamp Luminous Flux Corrected ($8\log(F/F_0) = 5.4$)
Area: 0.1 m²

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.0DEG
Operators:朱法春
Test Date:2023-02-11

γ Range: 0 - 180DEG
 γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.0.366
Humidity:32%
Test Distance:1.100m [K=1.0954]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:220.99V I:0.1529A P:33.145W PF:0.9810 Freq:50.00Hz Lamp Flux:2386.67x2 lm		
NAME: IT-TRS-24-36	TYPE:3500K	WEIGHT:
SPEC.:2x4FT	DIM.:	SERIAL No.:
MFR.:	SUR.:0.53*1.1M	Shielding Angle:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS(PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	53	41	34	52	41	34	51	40	34	27
0.80	63	51	43	62	50	43	60	49	42	35
1.00	71	59	51	70	58	51	67	60	50	43
1.25	78	67	59	76	66	58	74	64	58	50
1.50	83	72	65	81	71	64	78	70	63	55
2.00	90	81	74	88	80	73	85	77	71	63
2.50	94	86	79	92	84	78	88	82	76	68
3.00	98	90	84	96	89	83	92	86	81	72
4.00	102	96	91	100	94	89	96	91	87	77
5.00	105	100	95	103	98	93	98	94	90	81
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 30.0DEG
 Test Speed: HIGH
 Temperature:25.0DEG
 Operators:朱法春
 Test Date:2023-02-11

γ Range: 0 - 180DEG
 γ Interval: 0.5DEG
 Test System:EVERFINE GO-R5000_V2 SYSTEM V2.0.366
 Humidity:32%
 Test Distance:1.100m [K=1.0954]
 Remarks:

ISOCANDELA DIAGRAM

Test:U:220.99V I:0.1529A P:33.145W PF:0.9810 Freq:50.00Hz Lamp Flux:2386.67x2 lm		
NAME: IT-TRS-24-36	TYPE:3500K	WEIGHT:
SPEC.:2x4FT	DIM.:	SERIAL No.:
MFR.:	SUR.:0.53*1.1M	Shielding Angle:

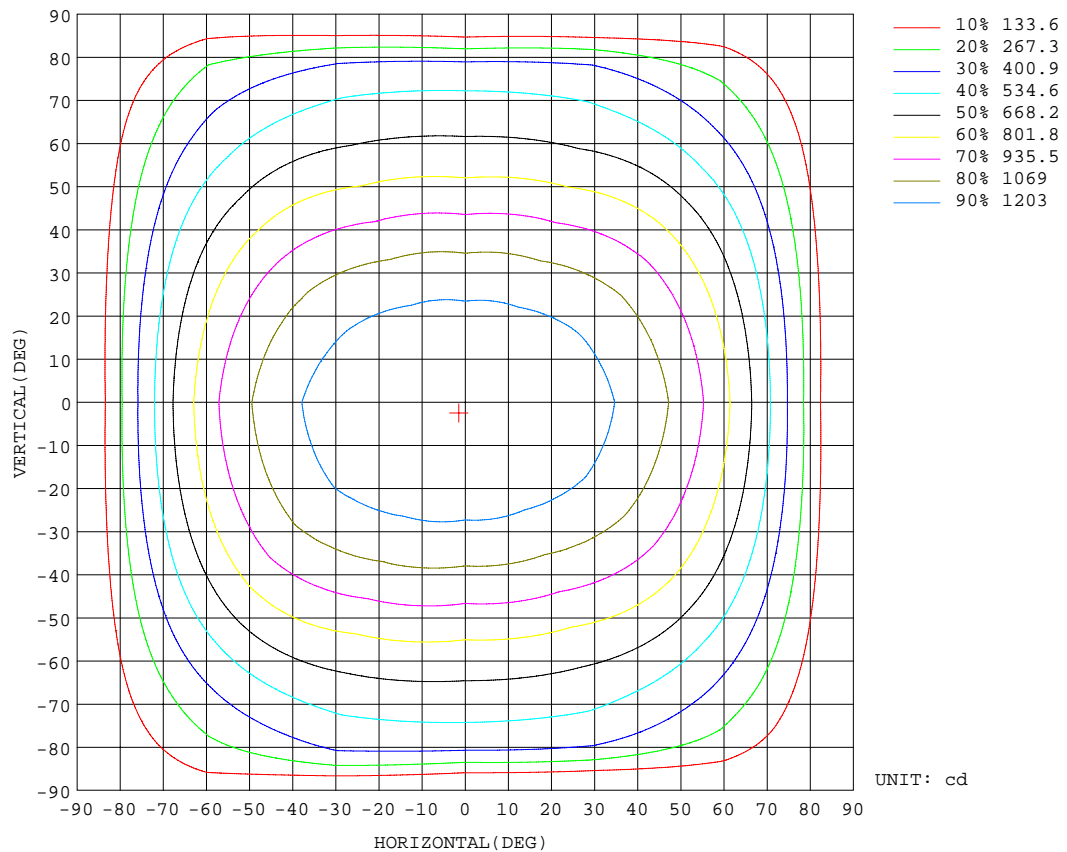


C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.0DEG
Operators:朱法春
Test Date:2023-02-11

γ Range: 0 - 180DEG
 γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.0.366
Humidity:32%
Test Distance:1.100m [K=1.0954]
Remarks:

AAI CURVES

Test:U:220.99V I:0.1529A P:33.145W PF:0.9810 Freq:50.00Hz Lamp Flux:2386.67x2 lm		
NAME: IT-TRS-24-36	TYPE:3500K	WEIGHT:
SPEC.:2x4FT	DIM.:	SERIAL No.:
MFR.:	SUR.:0.53*1.1M	Shielding Angle:

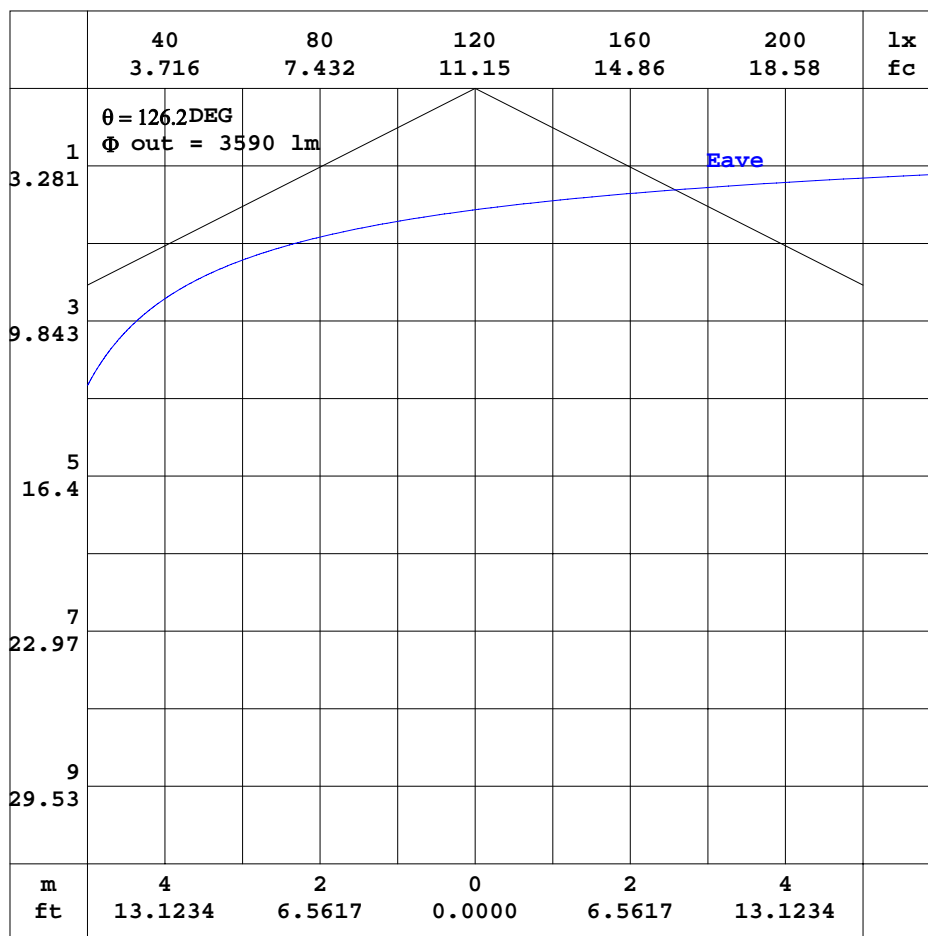


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
 C Interval: 30.0DEG
 Test Speed: HIGH
 Temperature:25.0DEG
 Operators:朱法春
 Test Date:2023-02-11

γ Range: 0 - 180DEG
 γ Interval: 0.5DEG
 Test System:EVERFINE GO-R5000_V2 SYSTEM V2.0.366
 Humidity:32%
 Test Distance:1.100m [K=1.0954]
 Remarks:

ISOLUX DIAGRAM

Test:U:220.99V I:0.1529A P:33.145W PF:0.9810 Freq:50.00Hz Lamp Flux:2386.67x2 lm		
NAME: IT-TRS-24-36	TYPE:3500K	WEIGHT:
SPEC.:2x4FT	DIM.:	SERIAL No.:
MFR.:	SUR.:0.53*1.1M	Shielding Angle:

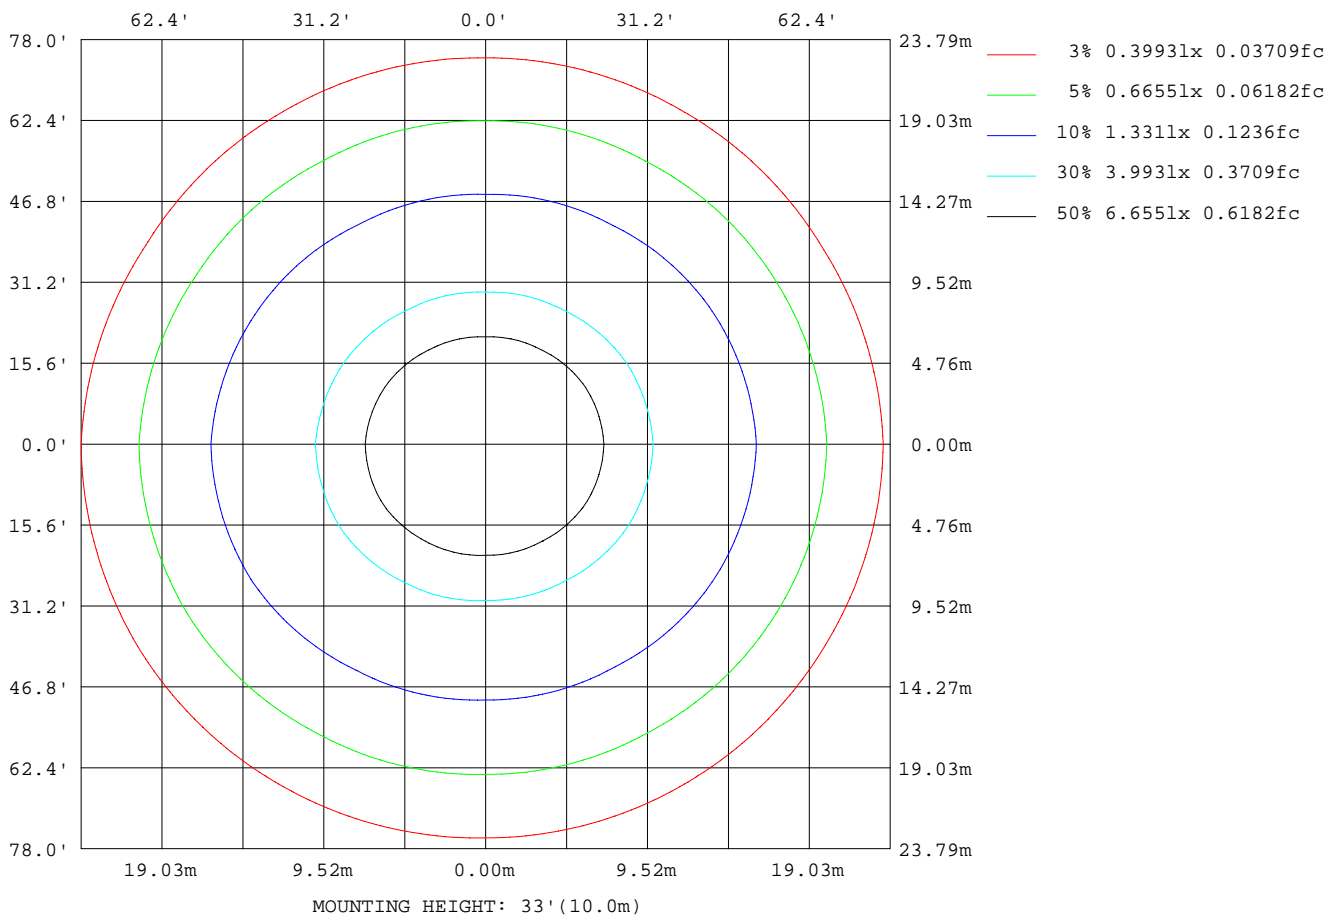

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature: 25.0DEG
Operators: 朱法春
Test Date: 2023-02-11

γ Range: 0 - 180DEG
 γ Interval: 0.5DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.0.366
Humidity: 32%
Test Distance: 1.100m [K=1.0954]
Remarks:

LED Avg.L Report

Test:U:220.99V I:0.1529A P:33.145W PF:0.9810 Freq:50.00Hz Lamp Flux:2386.67x2 lm		
NAME: IT-TRS-24-36	TYPE:3500K	WEIGHT:
SPEC.:2x4FT	DIM.:	SERIAL No.:
MFR.:	SUR.:0.53*1.1M	Shielding Angle:


AvgL	cd/m2
L_0~180(65)av	17225
L_0~180(75)av	15898
L_0~180(85)av	8596
L_90~270(65)av	15236
L_90~270(75)av	19646
L_90~270(85)av	17360
L_45(65)av	15824
L_45(75)av	18840
L_45(85)av	24870

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.0DEG
Operators:朱法春
Test Date:2023-02-11

γ Range: 0 - 180DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.0.366
Humidity:32%
Test Distance:1.100m [K=1.0954]
Remarks:

Planar Illuminance Curve

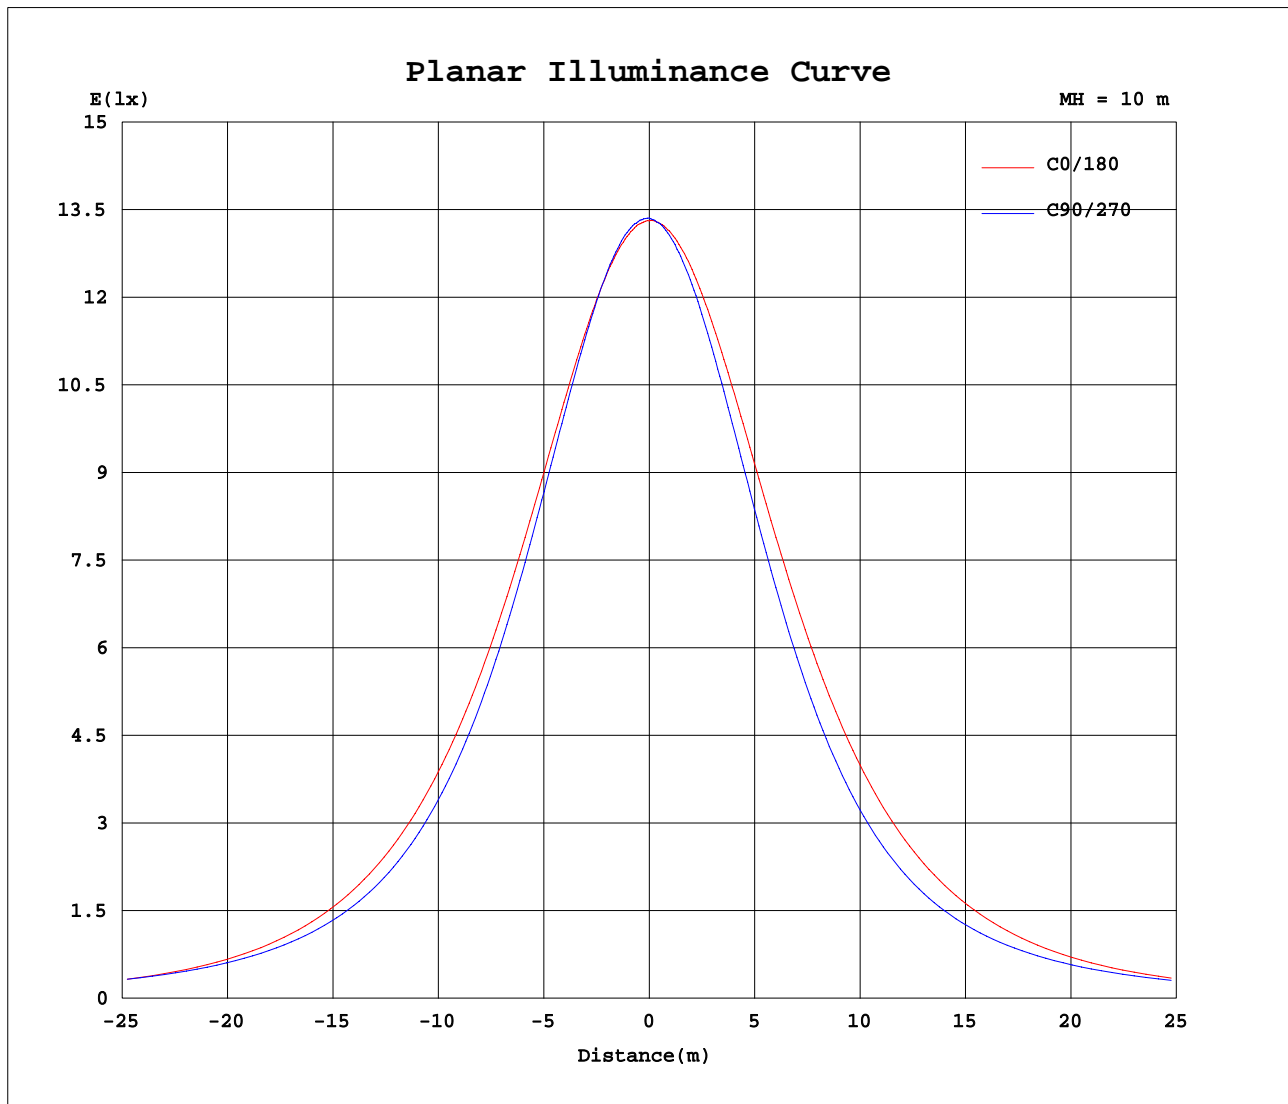

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature: 25.0DEG
Operators: 朱法春
Test Date: 2023-02-11

γ Range: 0 - 180DEG
 γ Interval: 0.5DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.0.366
Humidity: 32%
Test Distance: 1.100m [K=1.0954]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:220.99V I:0.1529A P:33.145W PF:0.9810 Freq:50.00Hz Lamp Flux:2386.67x2 lm																	
NAME: IT-TRS-24-36									TYPE:3500K						WEIGHT:		
SPEC.:2x4FT									DIM.:						SERIAL No.:		
MFR.:									SUR.:0.53*1.1M						Shielding Angle:		

Table--1

UNIT: cd

C(DEG) γ (DEG)	0	30	60	90	120	150	180	210	240	270	300	330						
0	1331	1333	1335	1336	1335	1334	1331	1333	1335	1336	1335	1334						
5	1328	1331	1333	1334	1335	1335	1330	1331	1328	1325	1326	1328						
10	1318	1323	1322	1322	1326	1330	1327	1321	1310	1305	1308	1316						
15	1307	1308	1302	1301	1308	1320	1318	1305	1285	1276	1282	1297						
20	1288	1287	1273	1268	1283	1304	1305	1282	1251	1236	1247	1274						
25	1266	1258	1233	1225	1247	1280	1286	1252	1208	1187	1203	1243						
30	1237	1222	1185	1173	1201	1249	1259	1215	1156	1128	1151	1205						
35	1200	1178	1127	1109	1147	1210	1226	1170	1095	1062	1091	1160						
40	1154	1125	1059	1038	1083	1160	1183	1114	1026	989	1022	1103						
45	1098	1060	985	962	1011	1100	1130	1050	950	912	947	1039						
50	1026	983	903	881	930	1027	1061	971	870	833	866	962						
55	941	893	819	803	846	942	977	883	789	757	783	871						
60	836	794	740	731	764	841	873	784	711	689	703	770						
65	708	682	665	662	684	727	748	677	641	626	630	658						
70	559	565	591	595	607	603	598	568	574	562	562	543						
75	389	452	518	523	530	476	434	470	506	494	494	431						
80	213	339	430	425	449	354	251	368	402	358	392	318						
85	60.6	205	197	185	268	231	89.2	237	168	118	149	187						
90	1.02	1.15	0.85	1.32	10.1	17.3	5.54	6.12	0.76	0.68	0.64	0.88						
95	0.74	0.63	0.58	0.58	0.65	0.79	1.02	0.85	0.77	0.72	0.65	0.72						
100	0.74	0.69	0.64	0.63	0.66	0.83	0.86	0.85	0.80	0.76	0.65	0.64						
105	0.80	0.76	0.75	0.73	0.74	0.87	0.76	0.83	0.81	0.78	0.64	0.59						
110	0.85	0.79	0.87	0.87	0.84	0.91	0.69	0.81	0.84	0.81	0.62	0.53						
115	0.82	0.82	0.95	0.97	0.92	0.93	0.73	0.81	0.87	0.82	0.57	0.52						
120	0.77	0.78	1.02	1.00	0.96	0.90	0.72	0.82	0.86	0.81	0.58	0.49						
125	0.68	0.76	1.06	1.07	0.97	0.86	0.73	0.81	0.85	0.79	0.60	0.49						
130	0.70	0.77	1.02	1.07	0.96	0.85	0.73	0.81	0.85	0.77	0.62	0.51						
135	0.72	0.81	1.00	1.06	0.95	0.85	0.71	0.85	0.85	0.77	0.65	0.56						
140	0.75	0.82	1.02	1.00	0.94	0.82	0.69	0.88	0.88	0.79	0.70	0.58						
145	0.75	0.82	0.99	0.92	0.88	0.79	0.65	0.89	0.91	0.82	0.72	0.62						
150	0.76	0.80	0.95	0.85	0.84	0.80	0.68	0.89	0.94	0.82	0.69	0.65						
155	0.75	0.76	0.83	0.79	0.79	0.77	0.73	0.87	0.95	0.80	0.64	0.68						
160	0.76	0.75	0.72	0.71	0.75	0.75	0.76	0.84	0.96	0.77	0.60	0.67						
165	0.74	0.73	0.60	0.64	0.66	0.77	0.79	0.82	0.96	0.80	0.64	0.68						
170	0.76	0.73	0.60	0.58	0.64	0.78	0.80	0.81	0.94	0.81	0.70	0.68						
175	0.75	0.76	0.72	0.67	0.68	0.74	0.80	0.81	0.89	0.80	0.72	0.71						
180	0.77	0.82	0.81	0.74	0.69	0.72	0.78	0.78	0.82	0.80	0.73	0.69						

C Range: 0 - 360DEG
 C Interval: 30.0DEG
 Test Speed: HIGH
 Temperature:25.0DEG
 Operators:朱法春
 Test Date:2023-02-11

γ Range: 0 - 180DEG
 γ Interval: 0.5DEG
 Test System:EVERFINE GO-R5000_V2 SYSTEM V2.0.366
 Humidity:32%
 Test Distance:1.100m [K=1.0954]
 Remarks: