


LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:221.02V I:0.1525A P:33.063W PF:0.9810 Freq:49.99Hz Lamp Flux:2386.67x2 lm					
NAME: IT-TRS-24-36		TYPE:5000		WEIGHT:	
SPEC.:2X4FT		DIM.:		SERIAL No.:	
MFR.:		SUR.:0.53*1.1M		Shielding Angle:	

DATA OF LAMP		PHOTOMETRIC DATA Eff: 145.20 lm/W			
MODEL		Imax(cd)	1365	S/MH(C0/180)	1.38
NOMINAL POWER(W)		LOR(%)	100.6	S/MH(C90/270)	1.26
RATED VOLTAGE(V)	220.0	TOTAL FLUX(lm)	4800.9	η UP,DN(C0-180)	0.1,50.8
NOMINAL FLUX(lm)	2386.67	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.1,49.6
LAMPS INSIDE	2	η up(%)	0.1	CIBSE SHR NOM	1.50
TEST VOLTAGE(V)	220.0	η down(%)	100.5	CIBSE SHR MAX	1.55

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

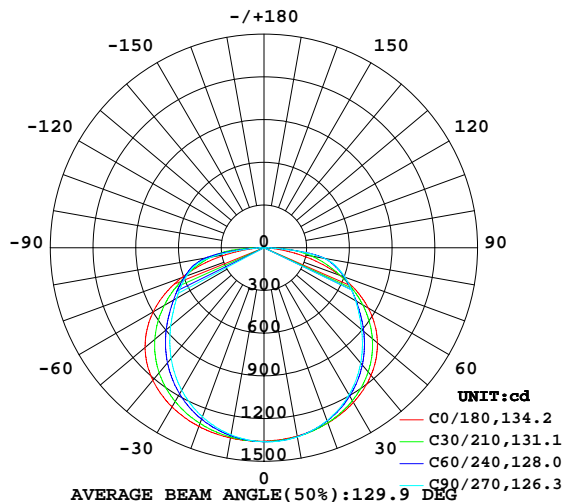

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

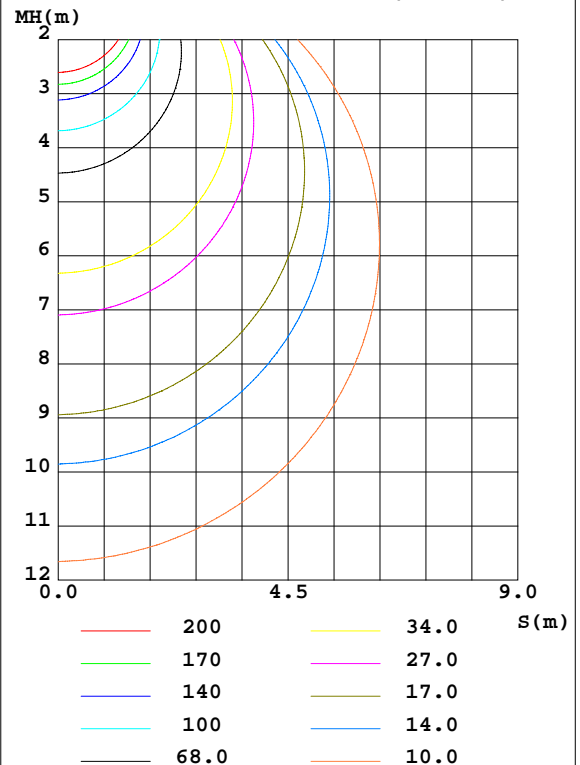

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature: 25.0DEG
Operators: 朱法春
Test Date: 2023-02-11

γ Range: 0 - 180DEG
 γ Interval: 0.5DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.0.366
Humidity: 32%
Test Distance: 1.100m [K=1.0954]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:


γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	$\%lum, lamp$
10	1344	1347	1349	1357	1356	1345	1333	1338	0- 10	129.2	129.2	2.69,2.71
20	1310	1302	1293	1322	1335	1297	1264	1285	10- 20	375.3	504.5	10.5,10.6
30	1254	1222	1193	1253	1291	1216	1155	1201	20- 30	584.4	1089	22.7,22.8
40	1170	1106	1057	1147	1215	1100	1014	1083	30- 40	733.5	1822	38,38.2
50	1040	953.8	895.4	1001	1090	948.5	855.6	931.3	40- 50	803.3	2626	54.7,55
60	845.5	774.1	742.9	819.2	896.4	771.0	707.8	751.4	50- 60	784.0	3410	71,71.4
70	565.6	584.9	604.2	618.7	614.0	589.4	578.7	564.3	60- 70	682.7	4092	85.2,85.7
80	218.1	388.1	430.5	409.3	256.7	398.0	369.5	364.7	70- 80	511.1	4603	95.9,96.4
90	2.549	1.081	1.343	13.73	5.520	3.544	0.6838	0.7604	80- 90	192.3	4796	99.9,100
100	0.7452	0.6788	0.6422	0.7580	0.8830	0.8345	0.7596	0.6448	90-100	0.9990	4797	99.9,100
110	0.8647	0.8490	0.8924	0.8976	0.7032	0.8312	0.8113	0.5764	100-110	0.8101	4798	99.9,101
120	0.7774	0.9203	1.019	0.9443	0.7382	0.8551	0.8177	0.5412	110-120	0.8134	4798	99.9,101
130	0.7057	0.9092	1.085	0.9220	0.7487	0.8381	0.7802	0.5718	120-130	0.7351	4799	100,101
140	0.7658	0.9374	1.012	0.8943	0.6999	0.8972	0.7952	0.6483	130-140	0.6405	4800	100,101
150	0.7692	0.8900	0.8633	0.8330	0.6943	0.9325	0.8309	0.6860	140-150	0.5206	4800	100,101
160	0.7735	0.7441	0.7215	0.7632	0.7779	0.9150	0.7808	0.6477	150-160	0.3681	4801	100,101
170	0.7724	0.6776	0.5918	0.7236	0.8166	0.8923	0.8169	0.6961	160-170	0.2128	4801	100,101
180	0.7919	0.8277	0.7417	0.7178	0.7894	0.8164	0.8149	0.7191	170-180	0.0726	4801	100,101
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

C Range: 0 - 360DEG
 C Interval: 30.0DEG
 Test Speed: HIGH
 Temperature:25.0DEG
 Operators:朱法春
 Test Date:2023-02-11

γ Range: 0 - 180DEG
 γ Interval: 0.5DEG
 Test System:EVERFINE GO-R5000_V2 SYSTEM V2.0.366
 Humidity:32%
 Test Distance:1.100m [K=1.0954]
 Remarks:

LUMINANCE LIMITATION CURVES

Test:U:221.02V I:0.1525A P:33.063W PF:0.9810 Freq:49.99Hz Lamp Flux:2386.67x2 lm		
NAME: IT-TRS-24-36	TYPE:5000	WEIGHT:
SPEC.:2X4FT	DIM.:	SERIAL No.:
MFR.:	SUR.:0.53*1.1M	Shielding Angle:

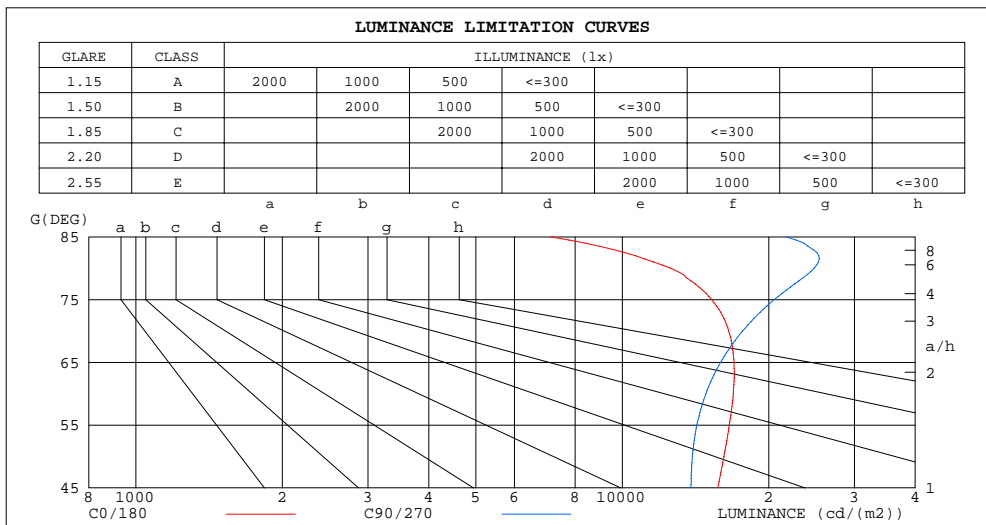

LUMINANCE cd/(m2)		
G(DEG)	C0/180	C90/270
85	7124	21685
80	12560	24794
75	15280	20524
70	16537	17665
65	16971	15922
60	16910	14858
55	16589	14223
50	16175	13930
45	15709	13821


C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature: 25.0DEG
Operators: 朱法春
Test Date: 2023-02-11

γ Range: 0 - 180DEG
 γ Interval: 0.5DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.0.366
Humidity: 32%
Test Distance: 1.100m [K=1.0954]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:221.02V I:0.1525A P:33.063W PF:0.9810 Freq:49.99Hz Lamp Flux:2386.67x2 lm		
NAME: IT-TRS-24-36	TYPE:5000	WEIGHT:
SPEC.:2X4FT	DIM.:	SERIAL No.:
MFR.:	SUR.:0.53*1.1M	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.20	1.20	1.20	1.17	1.17	1.17	1.12	1.12	1.12	1.07	1.07	1.07	1.03	1.03	1.03	1.00
1.0	1.02	.97	.92	.90	.95	.91	.95	.91	.88	.91	.88	.85	.88	.85	.83	.80
2.0	.87	.80	.73	.85	.78	.72	.82	.76	.71	.78	.73	.69	.75	.71	.67	.65
3.0	.76	.67	.60	.74	.66	.59	.71	.64	.58	.68	.62	.57	.66	.60	.56	.54
4.0	.67	.57	.50	.65	.56	.49	.63	.55	.49	.60	.53	.48	.58	.52	.47	.45
5.0	.59	.50	.42	.58	.49	.42	.56	.48	.42	.54	.47	.41	.52	.46	.41	.38
6.0	.53	.43	.37	.52	.43	.36	.50	.42	.36	.48	.41	.36	.47	.40	.35	.33
7.0	.48	.39	.32	.47	.38	.32	.45	.37	.32	.44	.37	.31	.43	.36	.31	.29
8.0	.44	.35	.28	.43	.34	.28	.41	.34	.28	.40	.33	.28	.39	.33	.28	.26
9.0	.40	.31	.25	.39	.31	.25	.38	.31	.25	.37	.30	.25	.36	.30	.25	.23
10.0	.37	.28	.23	.36	.28	.23	.35	.28	.23	.34	.27	.23	.33	.27	.23	.21

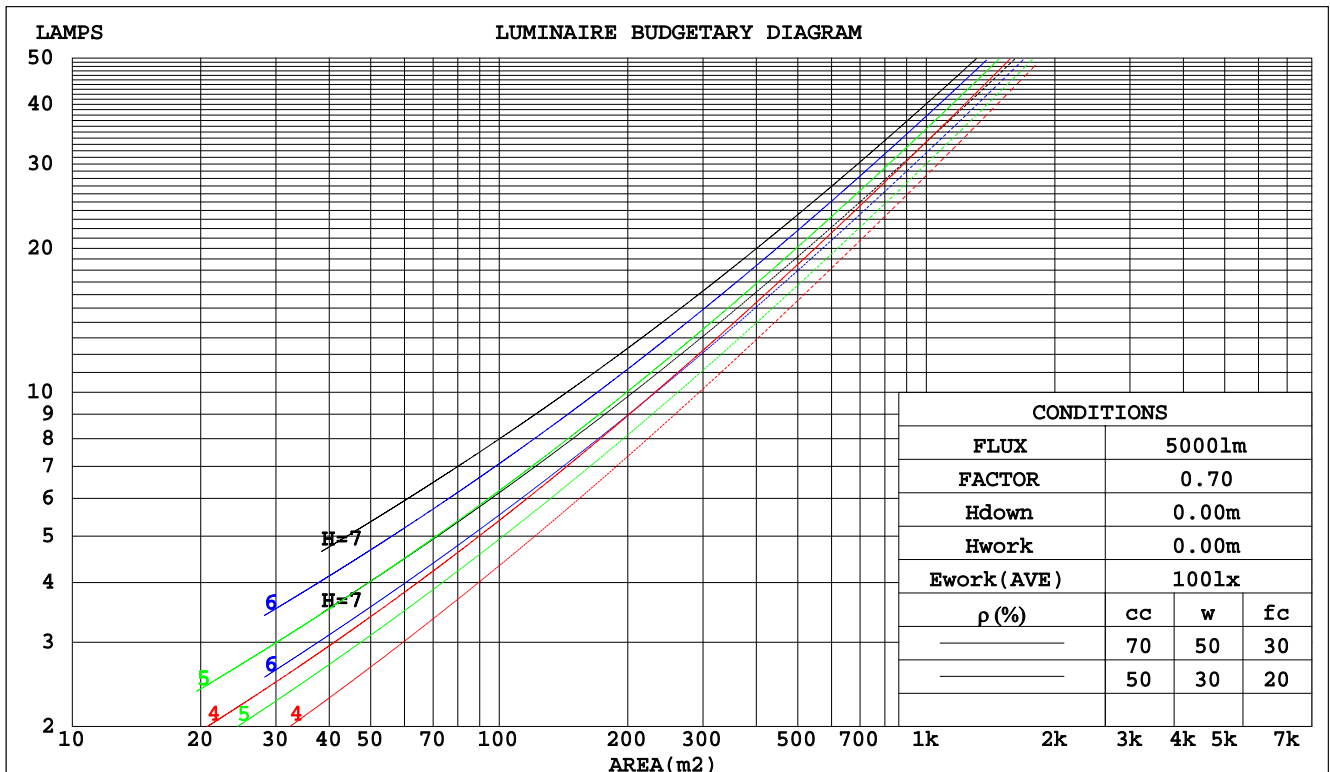

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.0DEG
Operators:朱法春
Test Date:2023-02-11

γ Range: 0 - 180DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.0.366
Humidity:32%
Test Distance:1.100m [K=1.0954]
Remarks:

WEC AND CCEC

Test:U:221.02V I:0.1525A P:33.063W PF:0.9810 Freq:49.99Hz Lamp Flux:2386.67x2 lm					
NAME: IT-TRS-24-36			TYPE:5000		WEIGHT:
SPEC.:2X4FT			DIM.:		SERIAL No.:
MFR.:			SUR.:0.53*1.1M		Shielding Angle:

pcc	80%			70%			50%			30%			10%			0	
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
pfc	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)										
0.0																	
1.0	.359	.204	.065	.352	.201	.064	.338	.194	.062	.326	.188	.060	.314	.182	.059		
2.0	.327	.179	.055	.320	.177	.054	.308	.171	.053	.297	.167	.052	.287	.162	.051		
3.0	.297	.158	.047	.291	.156	.047	.280	.152	.046	.270	.148	.045	.261	.144	.045		
4.0	.270	.140	.041	.265	.139	.041	.255	.135	.040	.246	.132	.040	.238	.129	.039		
5.0	.247	.126	.036	.242	.124	.036	.234	.122	.036	.226	.119	.035	.218	.117	.035		
6.0	.227	.114	.033	.223	.113	.032	.215	.110	.032	.208	.108	.032	.202	.106	.032		
7.0	.210	.104	.029	.206	.103	.029	.200	.101	.029	.193	.099	.029	.187	.097	.029		
8.0	.195	.095	.027	.192	.094	.027	.186	.093	.026	.180	.091	.026	.175	.090	.026		
9.0	.182	.088	.025	.179	.087	.024	.174	.086	.024	.169	.084	.024	.164	.083	.024		
10.0	.170	.082	.023	.168	.081	.023	.163	.080	.022	.158	.079	.022	.154	.077	.022		

pcc	80%			70%			50%			30%			10%			0	
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
pfc	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients(CCEC)										
0.0	.192	.192	.192	.164	.164	.164	.112	.112	.112	.064	.064	.064	.021	.021	.021		
1.0	.185	.157	.132	.159	.135	.114	.109	.093	.079	.062	.054	.046	.020	.017	.015		
2.0	.179	.133	.095	.153	.115	.082	.105	.079	.057	.060	.046	.034	.019	.015	.011		
3.0	.171	.116	.072	.147	.100	.062	.101	.070	.044	.058	.041	.026	.019	.013	.008		
4.0	.163	.103	.057	.140	.089	.049	.096	.062	.035	.056	.036	.021	.018	.012	.007		
5.0	.156	.093	.046	.134	.080	.040	.092	.056	.028	.053	.033	.017	.017	.011	.006		
6.0	.148	.084	.038	.127	.073	.034	.088	.051	.024	.051	.030	.014	.016	.010	.005		
7.0	.141	.077	.033	.121	.067	.029	.084	.047	.020	.049	.028	.012	.016	.009	.004		
8.0	.134	.072	.029	.115	.062	.025	.080	.044	.018	.046	.026	.011	.015	.008	.003		
9.0	.127	.067	.025	.110	.058	.022	.076	.041	.016	.044	.024	.009	.014	.008	.003		
10.0	.121	.062	.023	.105	.054	.020	.073	.038	.014	.042	.022	.008	.014	.007	.003		

C Range: 0 - 360DEG
 C Interval: 30.0DEG
 Test Speed: HIGH
 Temperature:25.0DEG
 Operators:朱法春
 Test Date:2023-02-11

γ Range: 0 - 180DEG
 γ Interval: 0.5DEG
 Test System:EVERFINE GO-R5000_V2 SYSTEM V2.0.366
 Humidity:32%
 Test Distance:1.100m [K=1.0954]
 Remarks:

UGR(Unified Glare Rating) Table

Test:U:221.02V I:0.1525A P:33.063W PF:0.9810 Freq:49.99Hz Lamp Flux:2386.67x2 lm											
NAME: IT-TRS-24-36						TYPE:5000			WEIGHT:		
SPEC.:2X4FT						DIM.:			SERIAL No.:		
MFR.:						SUR.:0.53*1.1M			Shielding Angle:		
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3	
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3	
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	
Room dimensions		Viewed crosswise					Viewed endwise				
x = 2H y = 2H	2H	22.7	24.4	23.0	24.6	24.8	22.1	23.8	22.4	24.0	24.2
	3H	24.6	26.1	24.9	26.4	26.6	24.4	25.9	24.7	26.2	26.4
	4H	25.4	26.8	25.7	27.1	27.4	25.6	27.1	26.0	27.3	27.6
	6H	25.9	27.3	26.3	27.6	27.9	26.9	28.2	27.2	28.5	28.8
	8H	26.1	27.4	26.4	27.7	28.0	27.4	28.7	27.7	29.0	29.3
	12H	26.1	27.4	26.5	27.7	28.0	27.7	29.0	28.1	29.3	29.6
4H	2H	23.4	24.8	23.7	25.1	25.4	23.0	24.4	23.3	24.7	24.9
	3H	25.5	26.8	25.9	27.1	27.4	25.4	26.7	25.8	27.0	27.3
	4H	26.5	27.6	26.9	28.0	28.3	26.8	28.0	27.2	28.3	28.7
	6H	27.2	28.2	27.6	28.6	29.0	28.3	29.3	28.7	29.7	30.0
	8H	27.4	28.4	27.8	28.8	29.2	28.9	29.8	29.3	30.2	30.6
	12H	27.5	28.4	27.9	28.8	29.2	29.2	30.1	29.7	30.5	30.9
8H	4H	27.0	28.0	27.4	28.4	28.8	27.3	28.3	27.7	28.7	29.1
	6H	28.0	28.8	28.4	29.2	29.7	29.0	29.8	29.5	30.3	30.7
	8H	28.4	29.1	28.8	29.5	30.0	29.8	30.5	30.2	30.9	31.4
	12H	28.6	29.3	29.1	29.7	30.2	30.3	30.9	30.7	31.4	31.8
12H	4H	27.1	28.0	27.6	28.4	28.8	27.4	28.3	27.8	28.7	29.1
	6H	28.2	29.0	28.7	29.4	29.9	29.2	29.9	29.6	30.3	30.8
	8H	28.7	29.3	29.2	29.8	30.3	30.0	30.6	30.5	31.1	31.6
Variations with the observer position at spacings:											
S = 1.0H	+ 0.1 / - 0.1					+ 0.1 / - 0.1					
1.5H	+ 0.2 / - 0.3					+ 0.1 / - 0.2					
2.0H	+ 0.1 / - 0.3					+ 0.1 / - 0.3					

CIE Pub.117, 4773 lm Total Lamp Luminous Flux Corrected ($8\log(F/F_0) = 5.4$)
Area: 0.1 m²

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.0DEG
Operators:朱法春
Test Date:2023-02-11

γ Range: 0 - 180DEG
 γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.0.366
Humidity:32%
Test Distance:1.100m [K=1.0954]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:221.02V I:0.1525A P:33.063W PF:0.9810 Freq:49.99Hz Lamp Flux:2386.67x2 lm		
NAME: IT-TRS-24-36	TYPE:5000	WEIGHT:
SPEC.:2X4FT	DIM.:	SERIAL No.:
MFR.:	SUR.:0.53*1.1M	Shielding Angle:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS(PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	54	42	35	54	42	34	52	41	34	27
0.80	64	52	44	63	51	43	61	50	43	36
1.00	72	60	52	71	60	52	69	61	51	44
1.25	80	68	60	78	67	60	75	66	59	51
1.50	85	74	66	83	73	65	80	71	64	56
2.00	92	82	75	90	81	74	86	79	73	64
2.50	96	88	81	94	86	80	90	83	78	69
3.00	100	92	86	98	91	85	94	88	83	73
4.00	105	98	93	102	96	91	98	93	89	79
5.00	107	102	97	105	100	95	100	96	92	83
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 30.0DEG
 Test Speed: HIGH
 Temperature: 25.0DEG
 Operators: 朱法春
 Test Date: 2023-02-11

γ Range: 0 - 180DEG
 γ Interval: 0.5DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.0.366
 Humidity: 32%
 Test Distance: 1.100m [K=1.0954]
 Remarks:

ISOCANDELA DIAGRAM

Test:U:221.02V I:0.1525A P:33.063W PF:0.9810 Freq:49.99Hz Lamp Flux:2386.67x2 lm		
NAME: IT-TRS-24-36	TYPE:5000	WEIGHT:
SPEC.:2X4FT	DIM.:	SERIAL No.:
MFR.:	SUR.:0.53*1.1M	Shielding Angle:

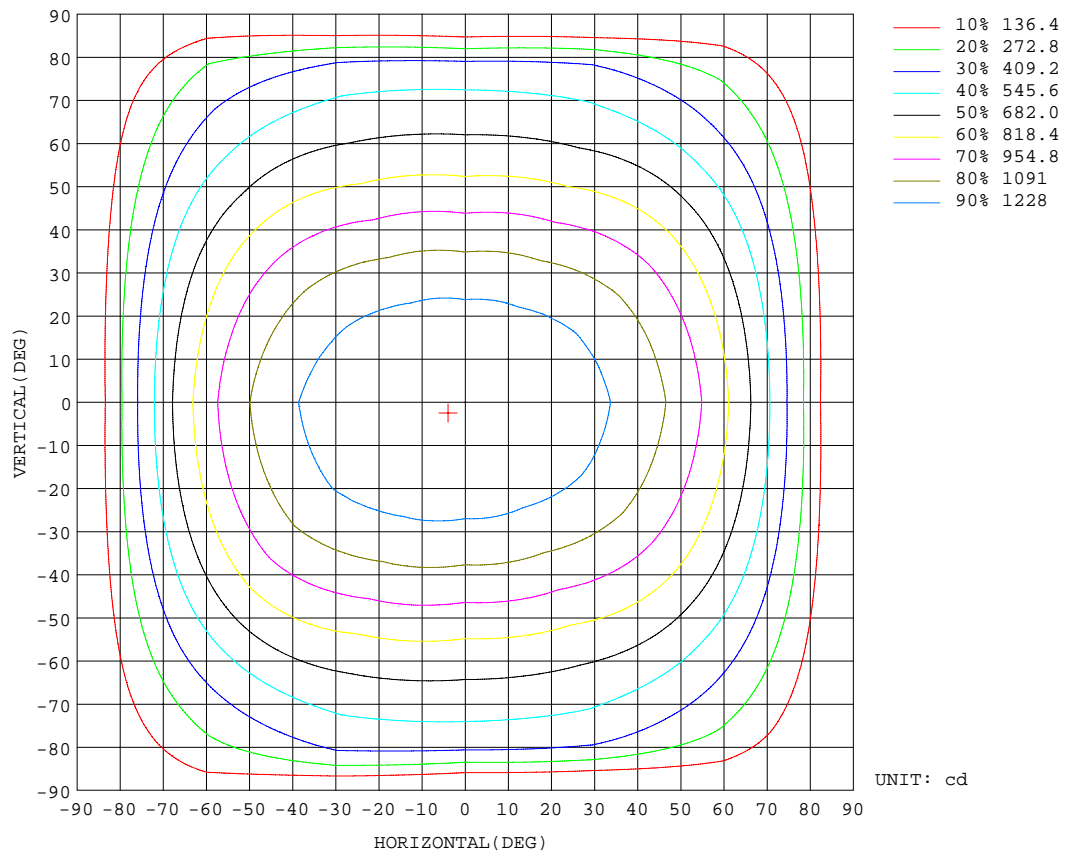


C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature: 25.0DEG
Operators: 朱法春
Test Date: 2023-02-11

γ Range: 0 - 180DEG
 γ Interval: 0.5DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.0.366
Humidity: 32%
Test Distance: 1.100m [K=1.0954]
Remarks:

AAI CURVES

Test:U:221.02V I:0.1525A P:33.063W PF:0.9810 Freq:49.99Hz Lamp Flux:2386.67x2 lm		
NAME: IT-TRS-24-36	TYPE:5000	WEIGHT:
SPEC.:2X4FT	DIM.:	SERIAL No.:
MFR.:	SUR.:0.53*1.1M	Shielding Angle:

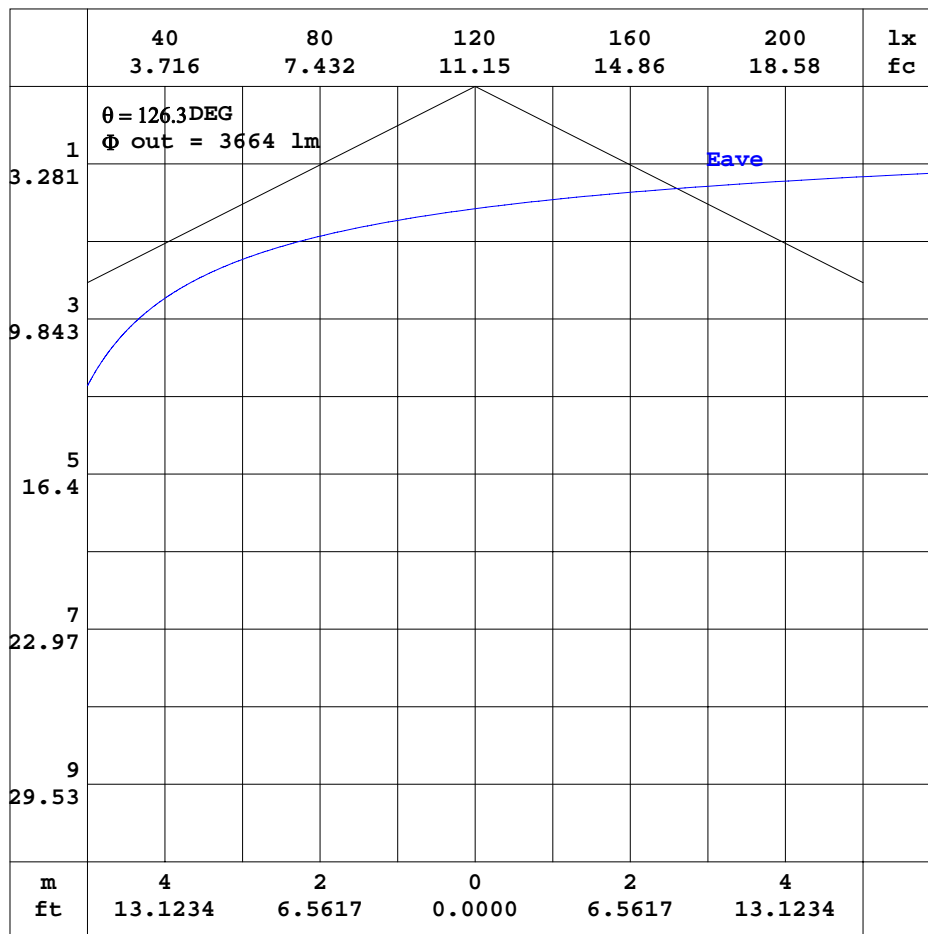


Note: The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
 C Interval: 30.0DEG
 Test Speed: HIGH
 Temperature: 25.0DEG
 Operators: 朱法春
 Test Date: 2023-02-11

γ Range: 0 - 180DEG
 γ Interval: 0.5DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.0.366
 Humidity: 32%
 Test Distance: 1.100m [K=1.0954]
 Remarks:

ISOLUX DIAGRAM

Test:U:221.02V I:0.1525A P:33.063W PF:0.9810 Freq:49.99Hz Lamp Flux:2386.67x2 lm		
NAME: IT-TRS-24-36	TYPE:5000	WEIGHT:
SPEC.:2X4FT	DIM.:	SERIAL No.:
MFR.:	SUR.:0.53*1.1M	Shielding Angle:

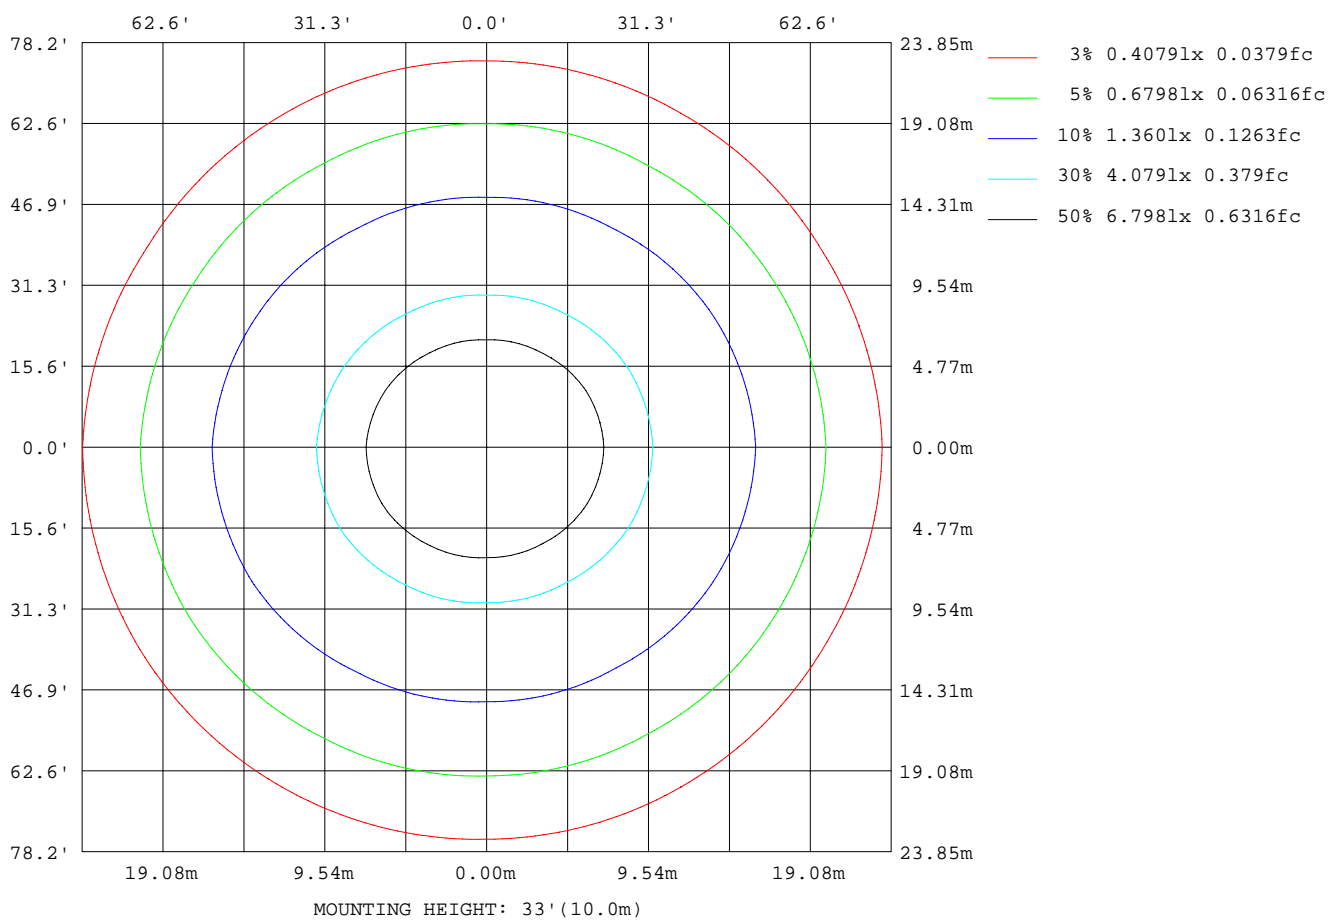

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature: 25.0DEG
Operators: 朱法春
Test Date: 2023-02-11

γ Range: 0 - 180DEG
γ Interval: 0.5DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.0.366
Humidity: 32%
Test Distance: 1.100m [K=1.0954]
Remarks:

LED Avg.L Report

Test:U:221.02V I:0.1525A P:33.063W PF:0.9810 Freq:49.99Hz Lamp Flux:2386.67x2 lm		
NAME: IT-TRS-24-36	TYPE:5000	WEIGHT:
SPEC.:2X4FT	DIM.:	SERIAL No.:
MFR.:	SUR.:0.53*1.1M	Shielding Angle:


AvgL	cd/m2
L_0~180(65)av	17565
L_0~180(75)av	16229
L_0~180(85)av	8790
L_90~270(65)av	15573
L_90~270(75)av	20091
L_90~270(85)av	17833
L_45(65)av	16150
L_45(75)av	19249
L_45(85)av	25370

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.0DEG
Operators:朱法春
Test Date:2023-02-11

γ Range: 0 - 180DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.0.366
Humidity:32%
Test Distance:1.100m [K=1.0954]
Remarks:

Planar Illuminance Curve

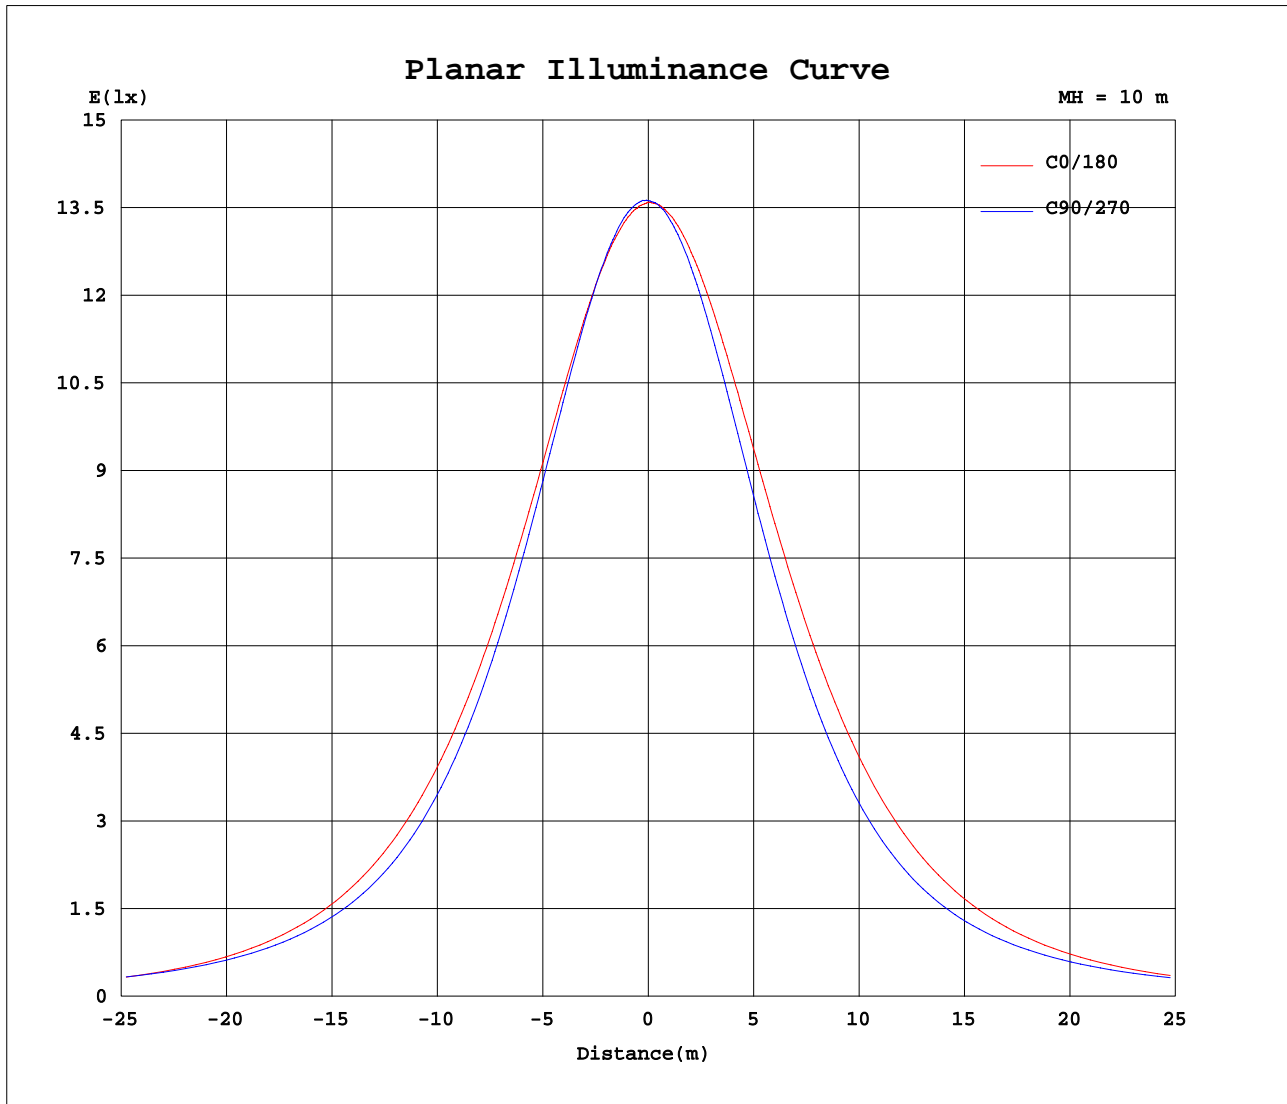

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature: 25.0DEG
Operators: 朱法春
Test Date: 2023-02-11

γ Range: 0 - 180DEG
 γ Interval: 0.5DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.0.366
Humidity: 32%
Test Distance: 1.100m [K=1.0954]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:221.02V I:0.1525A P:33.063W PF:0.9810 Freq:49.99Hz Lamp Flux:2386.67x2 lm																	
NAME: IT-TRS-24-36									TYPE:5000						WEIGHT:		
SPEC.:2X4FT									DIM.:						SERIAL No.:		
MFR.:									SUR.:0.53*1.1M						Shielding Angle:		

Table--1

UNIT: cd

C(DEG) γ (DEG)	0	30	60	90	120	150	180	210	240	270	300	330						
0	1360	1361	1362	1362	1362	1362	1360	1361	1362	1362	1362	1362						
5	1352	1357	1359	1361	1362	1364	1359	1358	1356	1354	1353	1355						
10	1344	1347	1347	1349	1354	1360	1356	1351	1340	1333	1334	1342						
15	1329	1332	1326	1326	1336	1350	1349	1335	1315	1304	1309	1323						
20	1310	1308	1295	1293	1309	1334	1335	1313	1281	1264	1272	1298						
25	1285	1278	1254	1248	1273	1309	1317	1285	1239	1215	1229	1266						
30	1254	1240	1204	1193	1226	1279	1291	1247	1186	1155	1175	1227						
35	1217	1194	1144	1129	1171	1238	1257	1202	1124	1089	1114	1180						
40	1170	1138	1074	1057	1105	1189	1215	1146	1054	1014	1044	1123						
45	1111	1072	997	977	1031	1127	1159	1079	978	937	967	1056						
50	1040	993	914	895	949	1052	1090	1001	896	856	885	977						
55	951	903	829	816	863	964	1004	910	813	778	802	887						
60	846	800	748	743	778	860	896	808	734	708	719	784						
65	717	688	671	673	698	743	767	698	662	643	645	671						
70	566	572	597	604	621	616	614	586	593	579	575	554						
75	395	456	523	531	541	485	445	485	524	509	506	441						
80	218	343	434	431	457	362	257	379	417	369	402	327						
85	62.1	207	200	189	272	234	91.1	245	173	122	151	194						
90	2.55	1.36	0.80	1.34	9.98	17.5	5.52	6.32	0.77	0.68	0.64	0.88						
95	0.74	0.64	0.59	0.59	0.66	0.82	1.05	0.85	0.77	0.72	0.64	0.71						
100	0.75	0.70	0.65	0.64	0.67	0.84	0.88	0.86	0.81	0.76	0.65	0.64						
105	0.82	0.77	0.77	0.75	0.75	0.88	0.78	0.85	0.81	0.79	0.64	0.59						
110	0.86	0.81	0.89	0.89	0.86	0.94	0.70	0.81	0.85	0.81	0.63	0.53						
115	0.84	0.84	0.97	0.99	0.93	0.95	0.75	0.83	0.87	0.83	0.57	0.52						
120	0.78	0.79	1.05	1.02	0.97	0.91	0.74	0.84	0.87	0.82	0.59	0.49						
125	0.69	0.77	1.08	1.08	0.99	0.88	0.75	0.82	0.86	0.80	0.61	0.49						
130	0.71	0.79	1.03	1.09	0.98	0.87	0.75	0.82	0.85	0.78	0.63	0.52						
135	0.73	0.82	1.01	1.08	0.96	0.87	0.73	0.87	0.87	0.78	0.66	0.56						
140	0.77	0.84	1.04	1.01	0.95	0.84	0.70	0.90	0.90	0.80	0.71	0.59						
145	0.76	0.83	1.01	0.94	0.90	0.80	0.66	0.91	0.92	0.83	0.73	0.63						
150	0.77	0.81	0.97	0.86	0.85	0.81	0.69	0.91	0.95	0.83	0.71	0.67						
155	0.76	0.77	0.84	0.80	0.80	0.79	0.74	0.89	0.97	0.81	0.65	0.69						
160	0.77	0.76	0.73	0.72	0.76	0.77	0.78	0.85	0.98	0.78	0.61	0.68						
165	0.76	0.74	0.61	0.65	0.67	0.78	0.80	0.84	0.98	0.81	0.64	0.69						
170	0.77	0.74	0.61	0.59	0.66	0.79	0.82	0.83	0.95	0.82	0.71	0.69						
175	0.77	0.78	0.74	0.68	0.69	0.75	0.82	0.82	0.91	0.81	0.73	0.72						
180	0.79	0.84	0.82	0.74	0.69	0.74	0.79	0.79	0.84	0.81	0.74	0.70						

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.0DEG
Operators:朱法春
Test Date:2023-02-11

γ Range: 0 - 180DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.0.366
Humidity:32%
Test Distance:1.100m [K=1.0954]
Remarks: