

LED WALLPACK LIGHT

INSTALLATION INSTRUCTIONS

Application:

Available in industrial lighting, landscape lighting, courtyard, building, hotel, building exterior, etc.

Caution:


1. Do not use the electric generator to test the LED lamp.
2. Please abide by related country, regional and local law and regulations when installing this fixture.
3. Please don't install the fixture when raining to lower the risk of electric shock and avoid failure.

Note:


1. To avoid the possibility of electrical shock or fire, the installation personnel must have professional electric knowledge.
2. Please wear gloves to avoid injury before installation.
3. If any smoke or spark of the wire happened, please turn off the power immediately and notify relevant personnel.

Installation I:


1. Turn off the power.

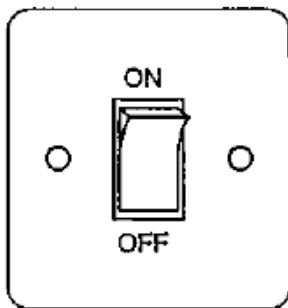


2. Loosen the 4 screws.

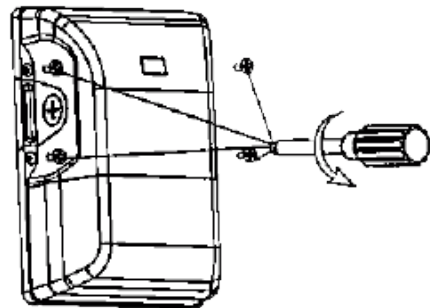

3. Remove the 1/2 end cap.

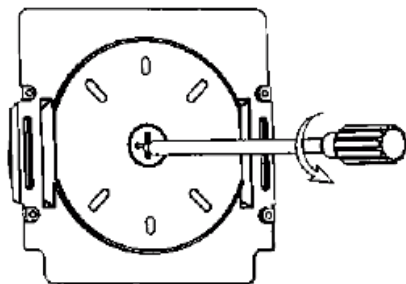


4. Peel off the yellow sticker and paste it on the round area of the bottom plate.

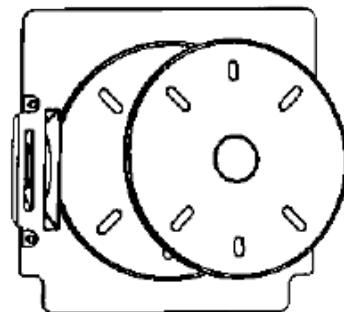


Installation Instructions


5. Secure the bottom plate on the round plate.

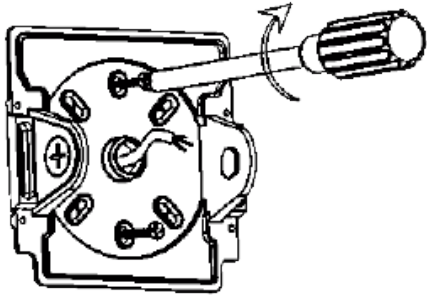


6. Make wiring connection and make sure the connection is secure.

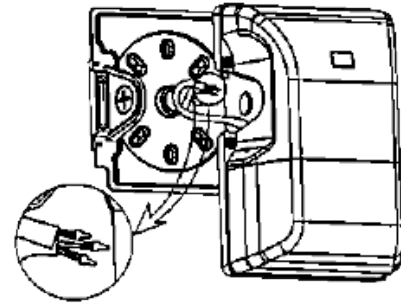

7. Secure the fixture by 4 screws.

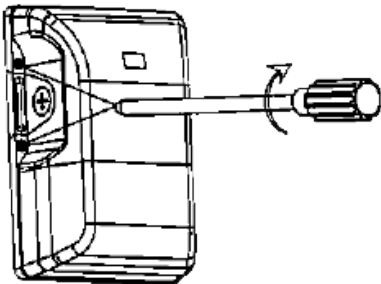


8. Make sure good wiring and screws fastening, then turn on the power.

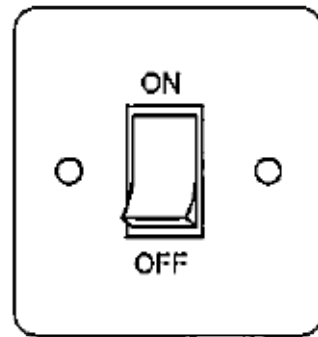


Installation II:


1. Turn off the power.




2. Loosen the 4 screws.

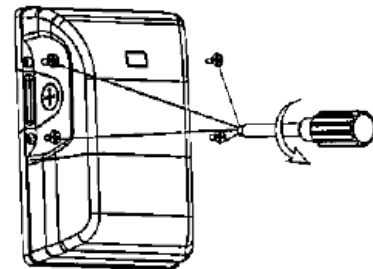

3. Paste the black sponge pad on the bottom plate

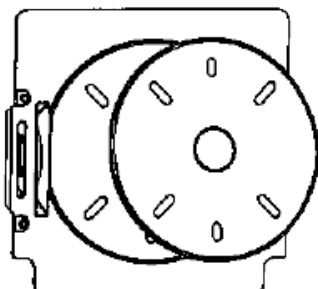


4. Screw the bottom plate on the wall.

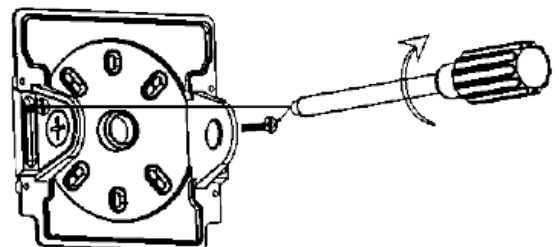


Installation Instructions


5. Remove one of the 1/2 end cap and get through wire.

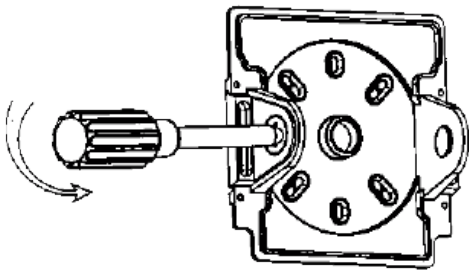


6. Make wiring connection and make sure the connection is secure.

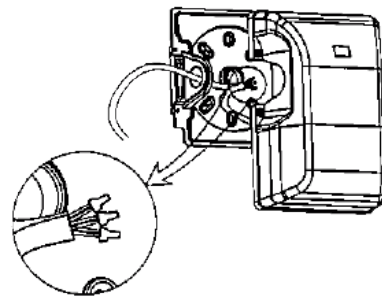

7. Return on the fixture to the bottom plate and tighten it with screws.

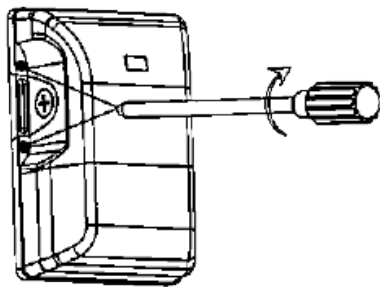

8. Turn on the power after make sure good wiring and insulation.



Standard wire:

Ulive wire:Black\Brown;

N/null wire:White\Blue;

Ground wire:Green\Yellow-green.

Warning/Avertissement:

MIN 75 °C SUPPLY CONDUCTOR OFF

CONSULT A QUALIFIED ELECTRICIAN TO ENSURE CORRECT BRANCH CIRCUIT

THIS PRODUCT MUST BE INSTALLED IN ACCORDANCE WITH THE APPLICABLE INSTALLATION CODE BY A PERSON FAMILIAR WITH THE CONSTRUCTION AND OPERATION OF THE PRODUCT AND THE HAZARDS INVOLVED.

LES FILS D'ALIMENTATION 75 °C MIN

CONDUCTOR CONSULTER UN ELECTRICIEN QUALIFIE POUR VOUS ASSURER QUE LES CONDUCTEURS DE LA DERIVATION SONT ADEQUATS CE PRODUIT DOIT EVTRE INSTALLE SELON LE CODE D'INSTALLATION PERTINENT, PAR UNE PERSONNE QUI CONNAIT BIEN LE PRODUIT ET SON FONCTIONNEMENT AINSI QUE LERISQUES INHERENTS.